


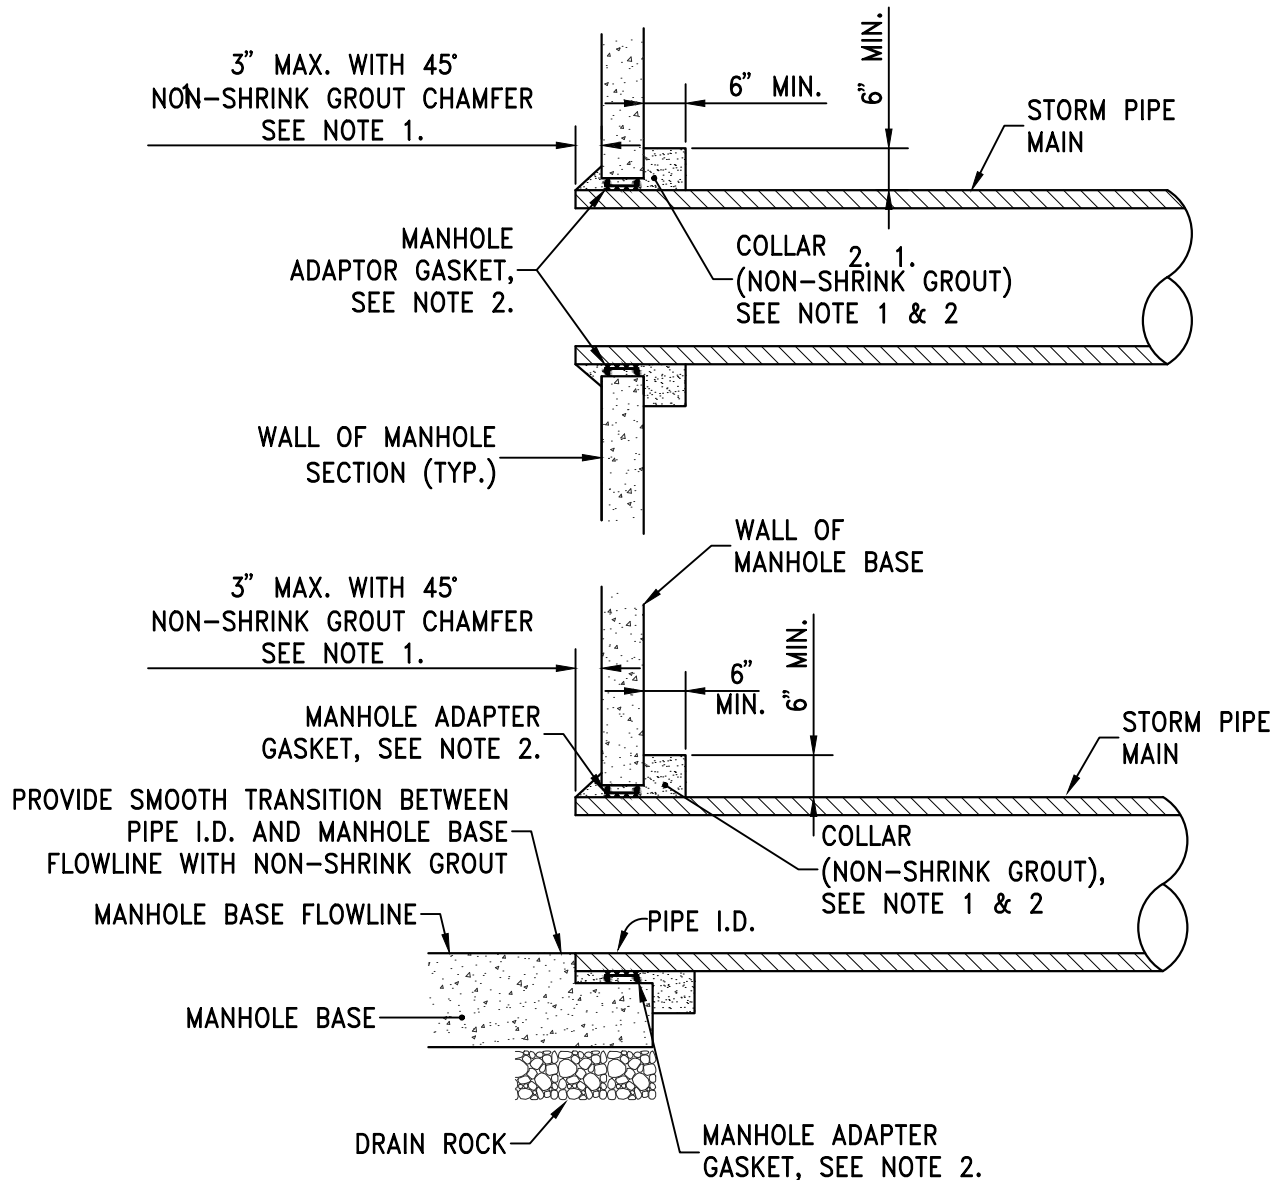

NOTE:

1. NON-SHRINK GROUT SHALL HAVE THE FOLLOWING CHARACTERISTICS: 3000 PSI MIN. COMPRESSIVE STRENGTH AT 28 DAYS, MIN. 6 SACKS OF CEMENT PER CUBIC YARD AND SLUMP AT 1 TO 4 INCHES. ALL MATERIAL SHALL CONFORM TO SSPWC SECTION 202, AS ADOPTED BY CITY COUNCIL.
2. STORM DRAIN PIPE CONNECTIONS TO MANHOLE BASES AND SECTIONS REQUIRE AN AGENCY-APPROVED FORM OF SEAL OR WATER STOP AND IS REQUIRED ON ALL STORM DRAIN INSTALLATIONS TO PROVIDE A WATERTIGHT CONNECTION. UTILIZE A ROMAC STYLE "LCT" MANHOLE ADAPTER GASKET OR APPROVED EQUAL IN CONJUNCTION WITH THE NON-SHRINK GROUT.
3. A RESILIENT FLEXIBLE CONNECTOR INSTALLED IN ACCORDANCE WITH STANDARD DETAIL S-211C MAY BE USED TO SATISFY THE REQUIREMENTS OF NOTE 2 ABOVE.
4. ALL PIPE OPENINGS TO NEW MANHOLES MUST BE EITHER CAST-IN-PLACE OR PRE-FORMED AND PIPE OPENINGS TO EXISTING MANHOLES MUST BE CORE DRILLED.

STANDARD DETAILS FOR PUBLIC WORKS CONSTRUCTION

DRAWING No.



STORM DRAIN PIPE TO MANHOLE CONNECTION

S-211B

APPROVED BY: JE DATE: 1/2020