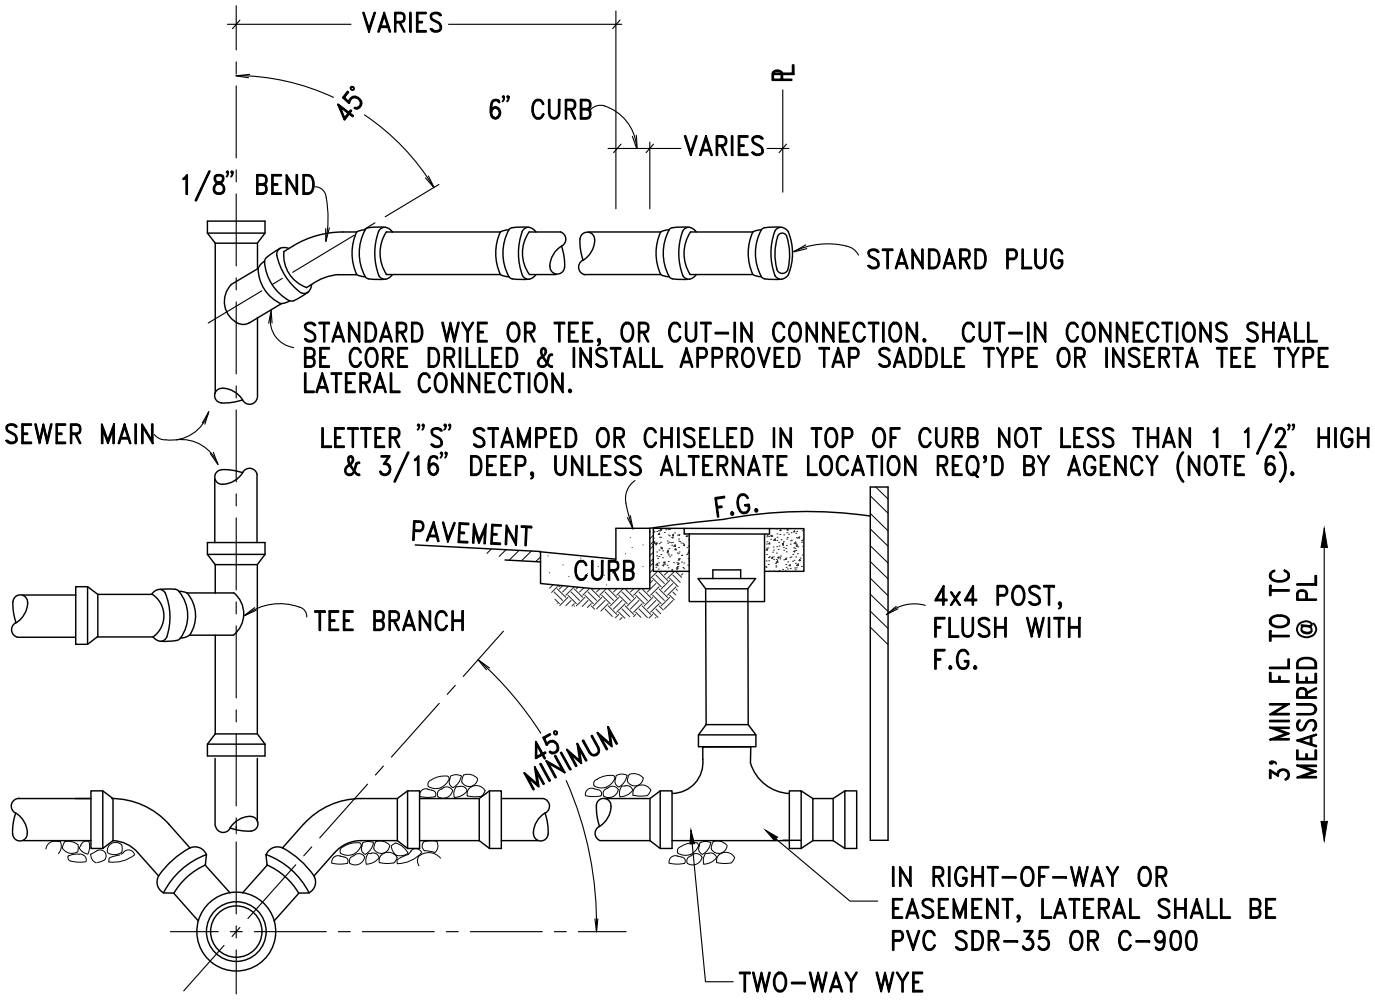

NOTES

1. SEWER LATERALS SHALL HAVE A MINIMUM SLOPE OF 2%, UNLESS OTHERWISE APPROVED BY THE CITY ENGINEER.
2. LATERAL SHALL BE CUT BACK TO SOUND MATERIAL FOR COUPLING.
3. ALL CONNECTIONS TO THE CITY SEWER MAINS MUST BE CORE DRILLED.
4. ENCASE LATERAL CONNECTION IN CEMENT, STABILIZED SAND OR 2000 PSI CONCRETE FOLLOWING INSTALLATION. CONNECTION MUST BE INSPECTED BY CITY PRIOR TO BACKFILL.
5. NO LATERAL CONNECTIONS SHALL BE MADE TO SANITARY SEWER "INTERCEPTOR" LINES WITHOUT THE APPROVAL OF THE CITY ENGINEER.
6. ALL APPLICABLE SANITARY SEWER PIPE INSTALLATION WORK SHALL BE IN ACCORDANCE WITH THE UNIFORM PLUMBING CODE.

STANDARD DETAILS FOR PUBLIC WORKS CONSTRUCTION		DRAWING No.
City of Sparks	SANITARY SEWER LATERAL	S-212A
		APPROVED BY: JE / DATE: 1/2020