


HINGES SHALL HAVE MINIMUM OF THREE $\frac{1}{2}$ " HOLES FOR FASTENING TO THE CONCRETE FACE OF THE OUTFALL OR INLET. HINGES TO BE PLACED AT THE TOP, SHALL BE HOT DIPPED GALVANIZED.

CHAIN SHALL BE HOT DIPPED GALVANIZED AND MINIMUM OF $\frac{1}{4}$ " CHAIN SHALL BE ANCHORED TO CONCRETE FACE BELOW OUTFALL OR INLET AND SHALL HAVE A CORRESPONDING LINK ON THE GATE SO THE GATE CAN BE SECURED.

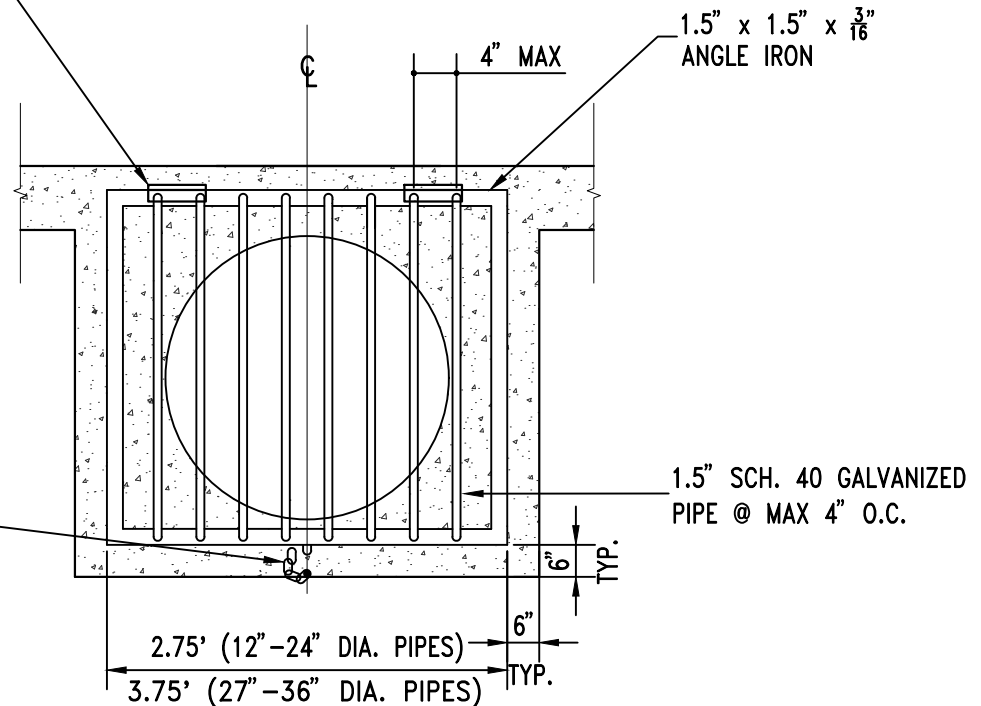

SECTION

NOTES:

1. ALL MATERIAL TO BE HOT DIPPED GALVANIZED.
2. ENGINEERS SHALL SUBMIT DETAILED PLANS FOR PIPES DIAMETERS GREATER THAN 36" OR WHEN REQUIRED BY THE CITY ENGINEER.

STANDARD DETAILS FOR PUBLIC WORKS CONSTRUCTION

DRAWING No.



ACCESS PREVENTION GATE

S-214B

APPROVED BY: JE DATE: 1/2020