


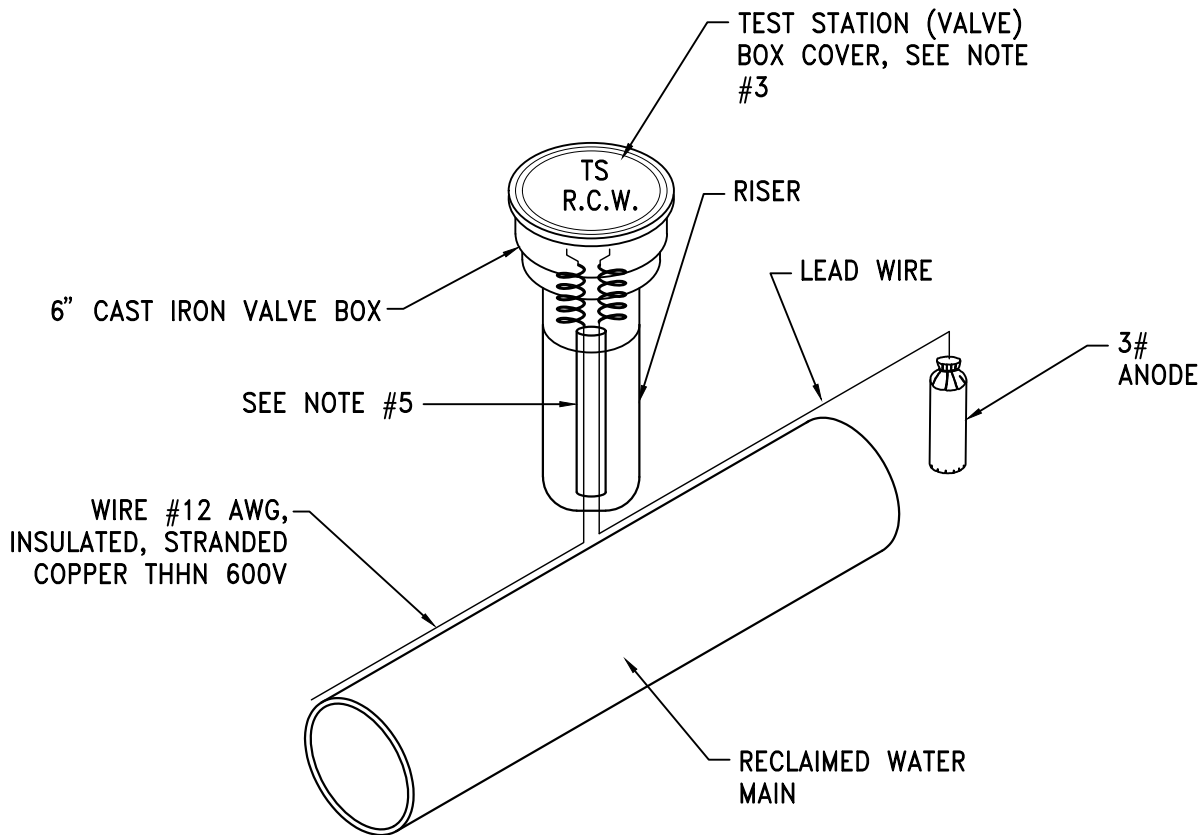

NOTES:

1. TEST STATIONS SHALL BE A MAXIMUM OF 500 FEET APART
2. A 3# ANODE WILL BE ATTACHED ON THE TRACER WIRE
3. TEST STATION BOX COVER SHALL BE EPOXY COATED PURPLE AND MARKED "TS R.C.W." OR SIMILAR
4. TEST LEAD WIRE TO BE LONG ENOUGH TO EXTEND FOUR (4) FEET ABOVE GROUND LEVEL AND SHALL TERMINATE IN TEST STATION BOX
5. USE 3/4" PVC OR PE PIPE AS A LEAD WIRE CONDUCTOR PIPE. PLACE APPROXIMATELY 6-INCHES ABOVE CARRIER PIPE AND INTO TEST STATION BOX

STANDARD DETAILS FOR PUBLIC WORKS CONSTRUCTION

DRAWING No.



TEST STATION

S-503

APPROVED BY: JE | DATE: 1/2020