


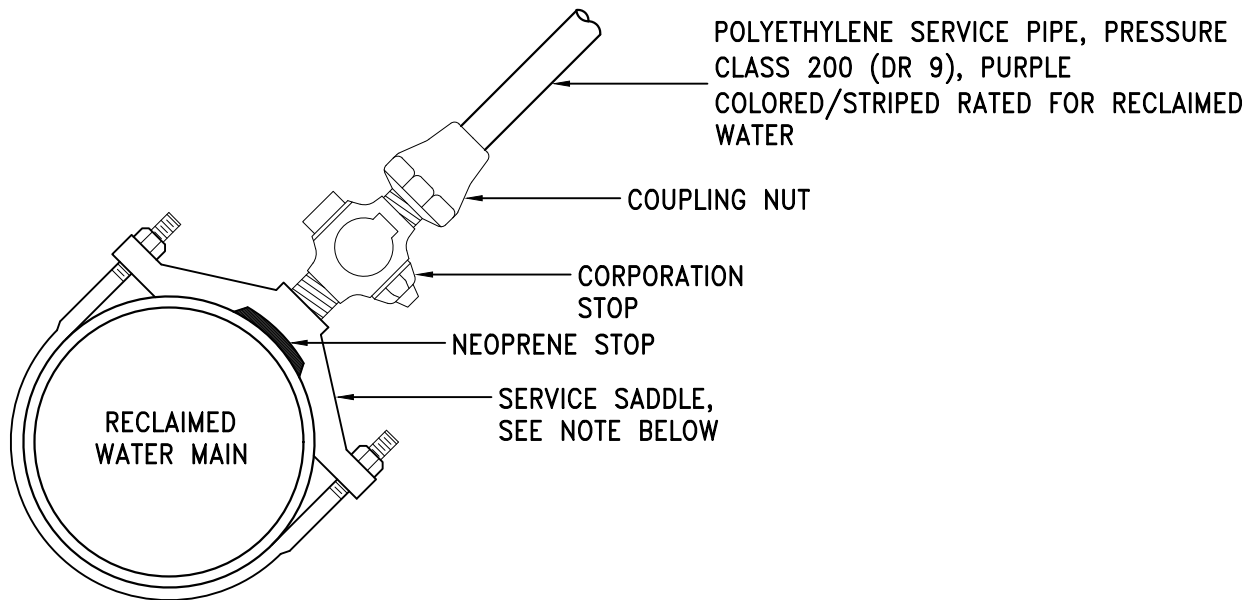

NOTES:

1. SADDLE TAP AND CORPORATION STOP SHALL BE THE SAME SIZE AS SERVICE LINE.
2. TAP SIZE SHALL NOT EXCEED MANUFACTURER'S RECOMMENDATIONS BASED ON MAINLINE SIZE. FOR LARGER TAPS IN EXCESS OF 2-INCH, USE TAPPING SLEEVE OR CUT-IN TEE.
3. SERVICE SADDLE SHALL BE A FACTORY FUSION BONDED EPOXY COATED OR NYLON COATED SADDLE WITH DOUBLE STAINLESS STEEL STRAP. PROVIDE CLAMP GASKET SUITABLE FOR USE WITH POTABLE WATER. MINIMUM WORKING PRESSURE OF 200 PSIG.
4. CORPORATION STOP. BRONZE ALLOY BODY WITH THREADED AND/OR COMPRESSION TYPE CONNECTIONS SUITABLE FOR SERVICE INTENDED. MINIMUM WORKING PRESSURE OF 200 PSIG.

STANDARD DETAILS FOR PUBLIC WORKS CONSTRUCTION		DRAWING No.	
	RECLAIMED WATER 1-1/2" & 2" SERVICE TAP		S-505
			APPROVED BY: JE DATE: 1/2020