


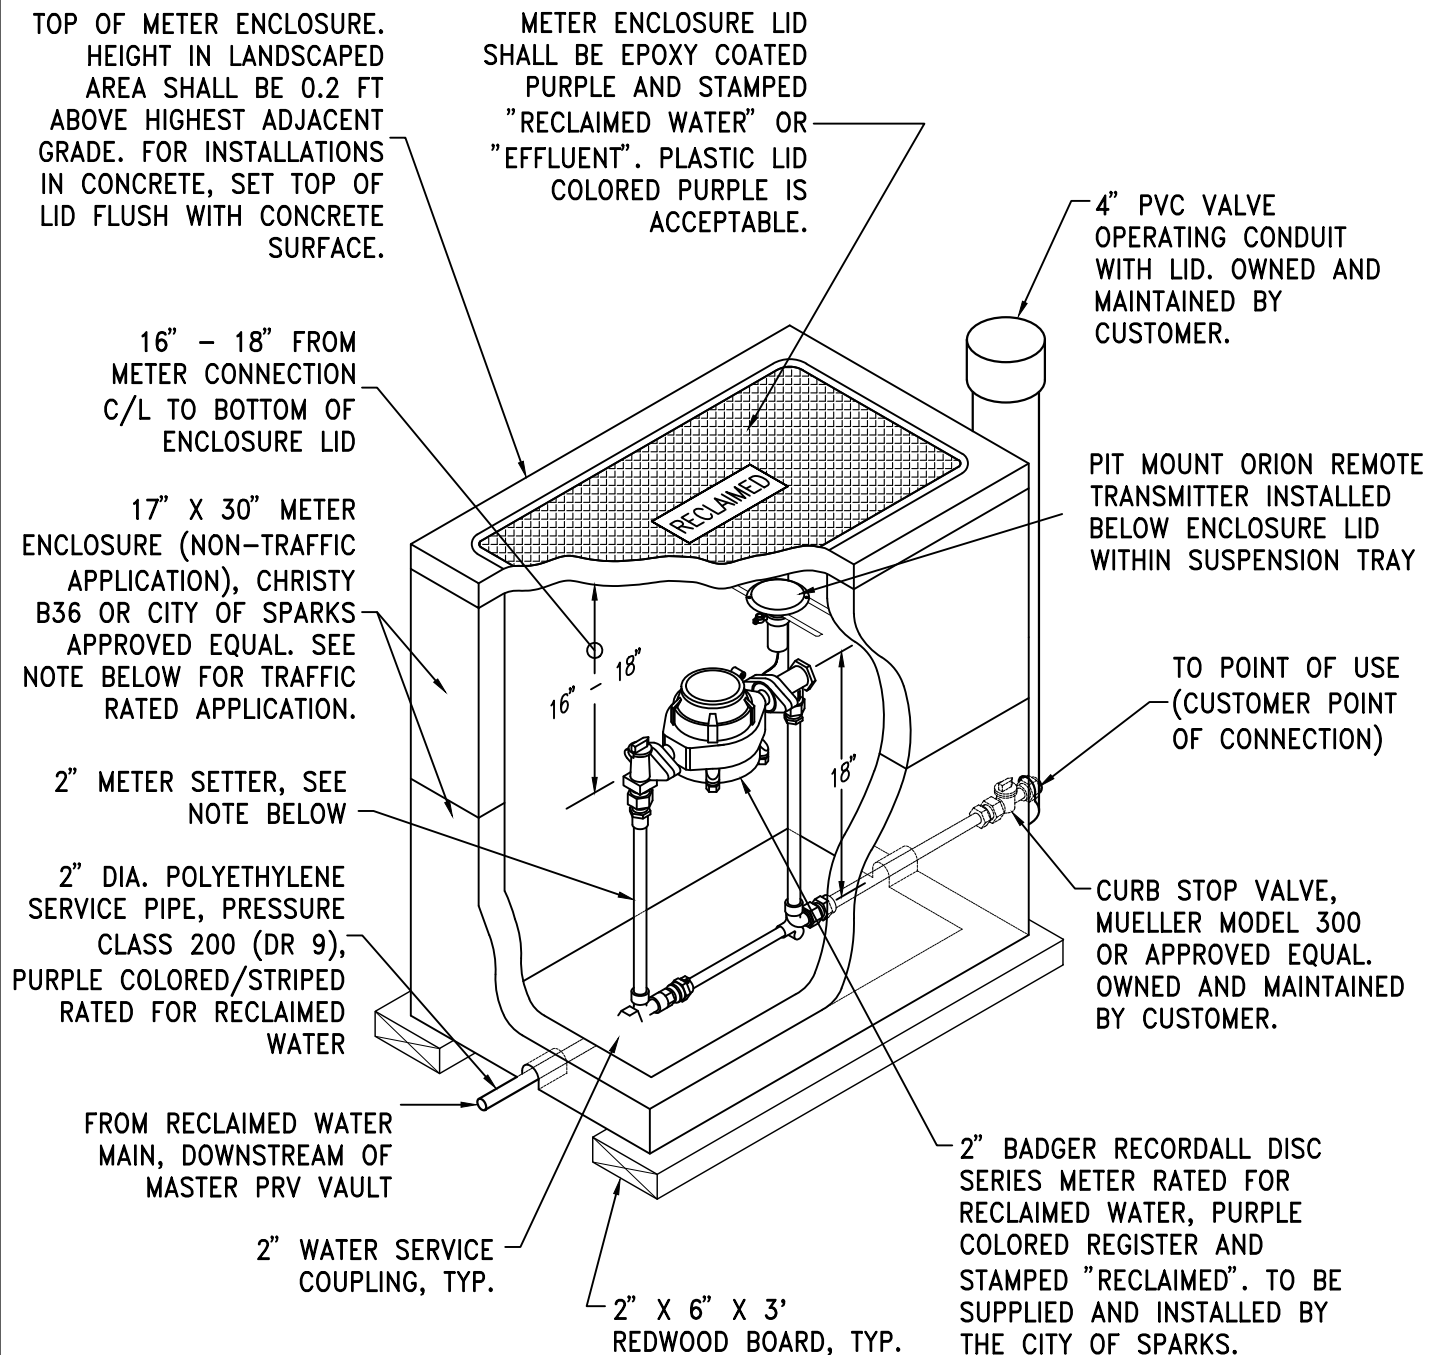

NOTES:

1. FOR DRIVEWAY OR INCIDENTAL TRAFFIC AREAS USE 17" X 30" ENCLOSURE AND LID APPROVED FOR TRAFFIC RATED H/20 LOADING. CHRISTY B1730 OR CITY OF SPARKS APPROVED EQUAL.
2. 2" METER SETTER SHALL BE EQUIPPED WITH KEY OR BALL VALVE INLET AND ANGLE CHECK VALVE OUTLET, FIP INLET AND OUTLET CONNECTIONS. SETTER SHALL NOT BE EQUIPPED WITH BYPASS. FORD 70 SERIES OR CITY OF SPARKS APPROVED EQUAL.
3. INSTALL TWO (2), 4' X 4' X 3/32" METER PIT INSULATING BLANKETS OVER METER AND SETTER.

STANDARD DETAILS FOR PUBLIC WORKS CONSTRUCTION

DRAWING No.



2" RECLAIMED WATER METER

S-507

APPROVED BY: JE DATE: 1/2020