
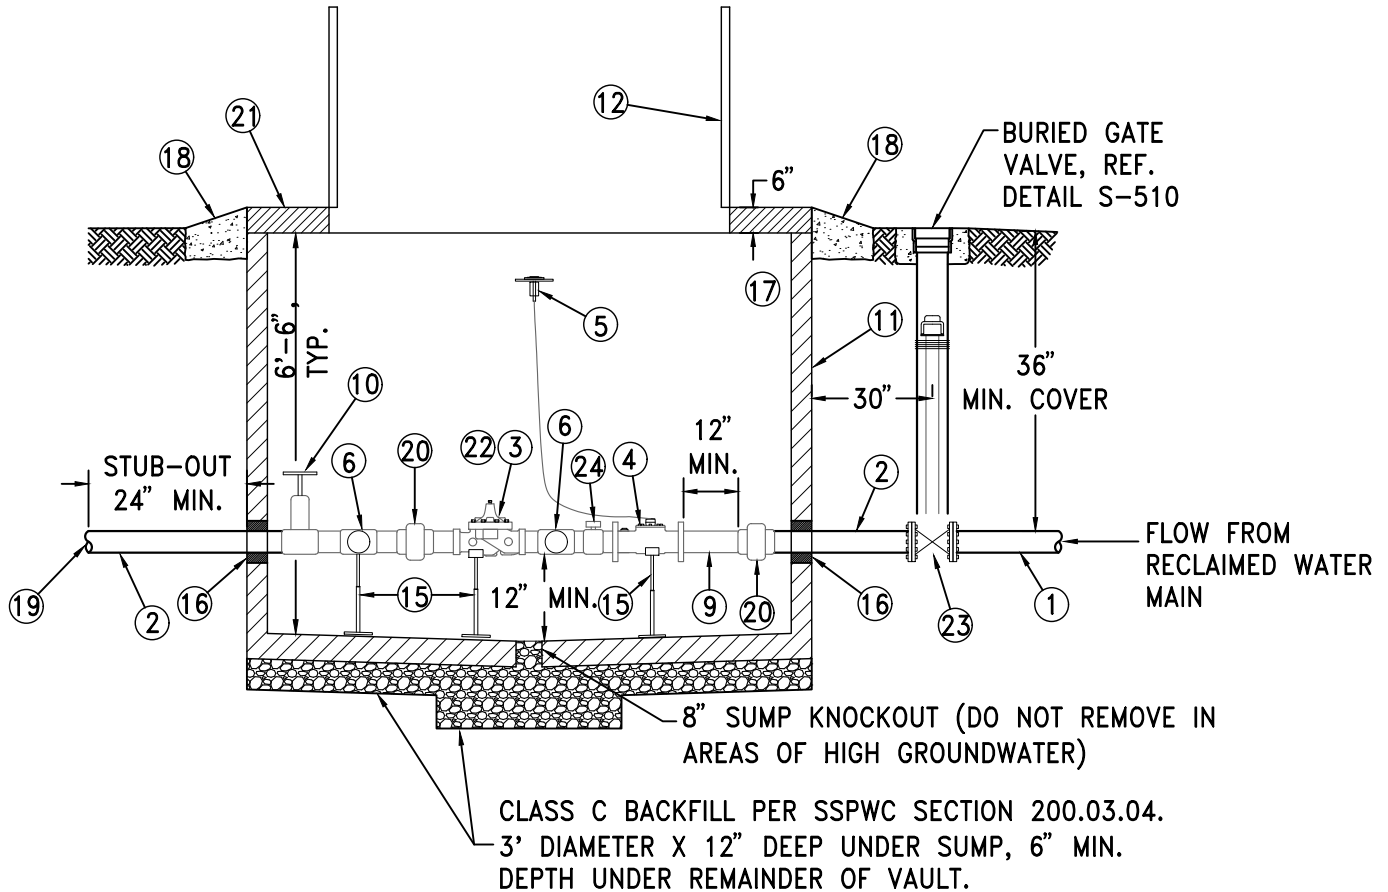


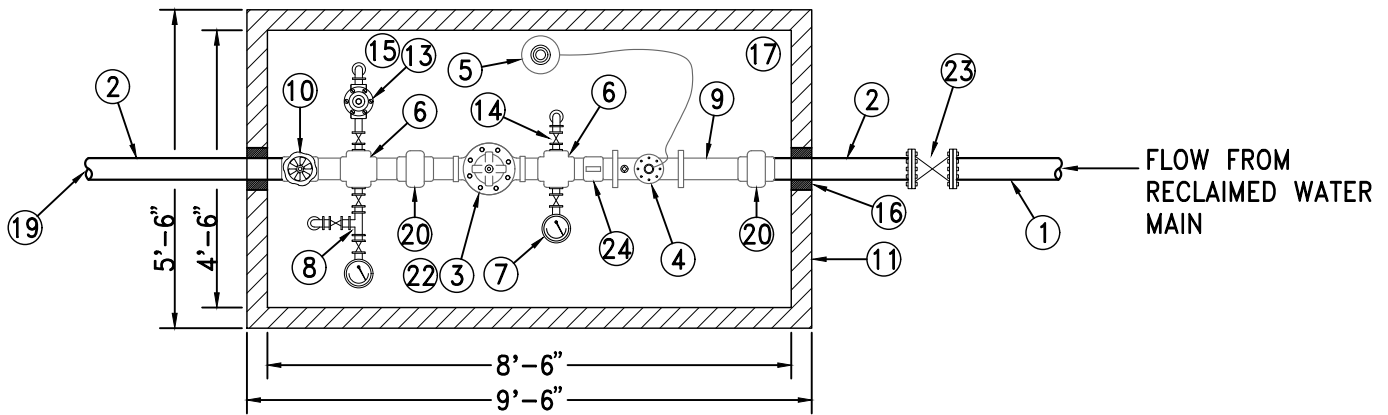

NOTES:

1. THIS DETAIL SHALL BE USED WHEN CONNECTING A SERVICE LINE DIRECTLY TO THE RECLAIMED WATER MAINLINE.
2. THE PRESSURE REDUCING VALVE SHALL REDUCE THE PRESSURE FROM THE MAIN DISTRIBUTION SYSTEM TO THE IRRIGATION DISTRIBUTION SYSTEM OPERATING PRESSURE.
3. INSTALL VAULT IN AN AREA DIRECTLY ACCESSIBLE BY VEHICLES. PROVIDE AN ALL-WEATHER ACCESS SURFACE TO TWO (2) SIDES OF THE VAULT, MINIMUM.
4. REFERENCE NOTES, SEE DETAIL S-508B.

STANDARD DETAILS FOR PUBLIC WORKS CONSTRUCTION

DRAWING No.



1-1/2" & 2" RECLAIMED
WATER PRV & METER VAULT

S-508A

APPROVED BY: JE DATE: 1/2020